



THE PORT AUTHORITY
OF NY & NJ



ORIGINAL SIGNED & SEALED BY
N.Y. P.E. (OR R.A.)

Joseph R. Loring & Associates, Inc.
consulting engineers
One Pennsylvania Plaza
New York, New York 10009-0045
Tel: (212) 512-7400, Fax: (212) 512-7362

THE OFFICE OF
DAVID ELIOT
REGISTERED PROFESSIONAL ENGINEER
IN THE STATE OF NEW YORK
No. 10000, Exp. 12/31/99

LESLIE E. ROBERTSON ASSOCIATES, P.L.L.C.
CONSULTING STRUCTURAL ENGINEERS
25 EAST 47TH STREET
NEW YORK, NY 10017-1001
TEL: (212) 697-0000 FAX: (212) 697-0001

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS FOR THE PROJECT IN WHICH SAID DRAWINGS WERE USED IN THE PERFORMANCE OF THE SAID CONTRACT WAS EXECUTED BY THE ENGINEER OF DESIGN.

DATE 11/17/97 *Stephen A. Belan*
DATE 11/17/97 *PL*
ENGINEER OF DESIGN

11/17/97 ISSUED FOR BIDDING

No. Date Revision Approved
Engineering Department
Design Divisions

The World Trade Center

STANDEY POWER
5 WORLD TRADE CENTER

FIRE PROTECTION


5 WTC PART PLAN
FUEL OIL TANK ROOM

This drawing is subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

VP M.A.R. VP
Designed by Drawn by Check by

Date 11/17/97 Scale AS SHOWN

Contract Number Drawing Number
WTC-945.071 FPI-01

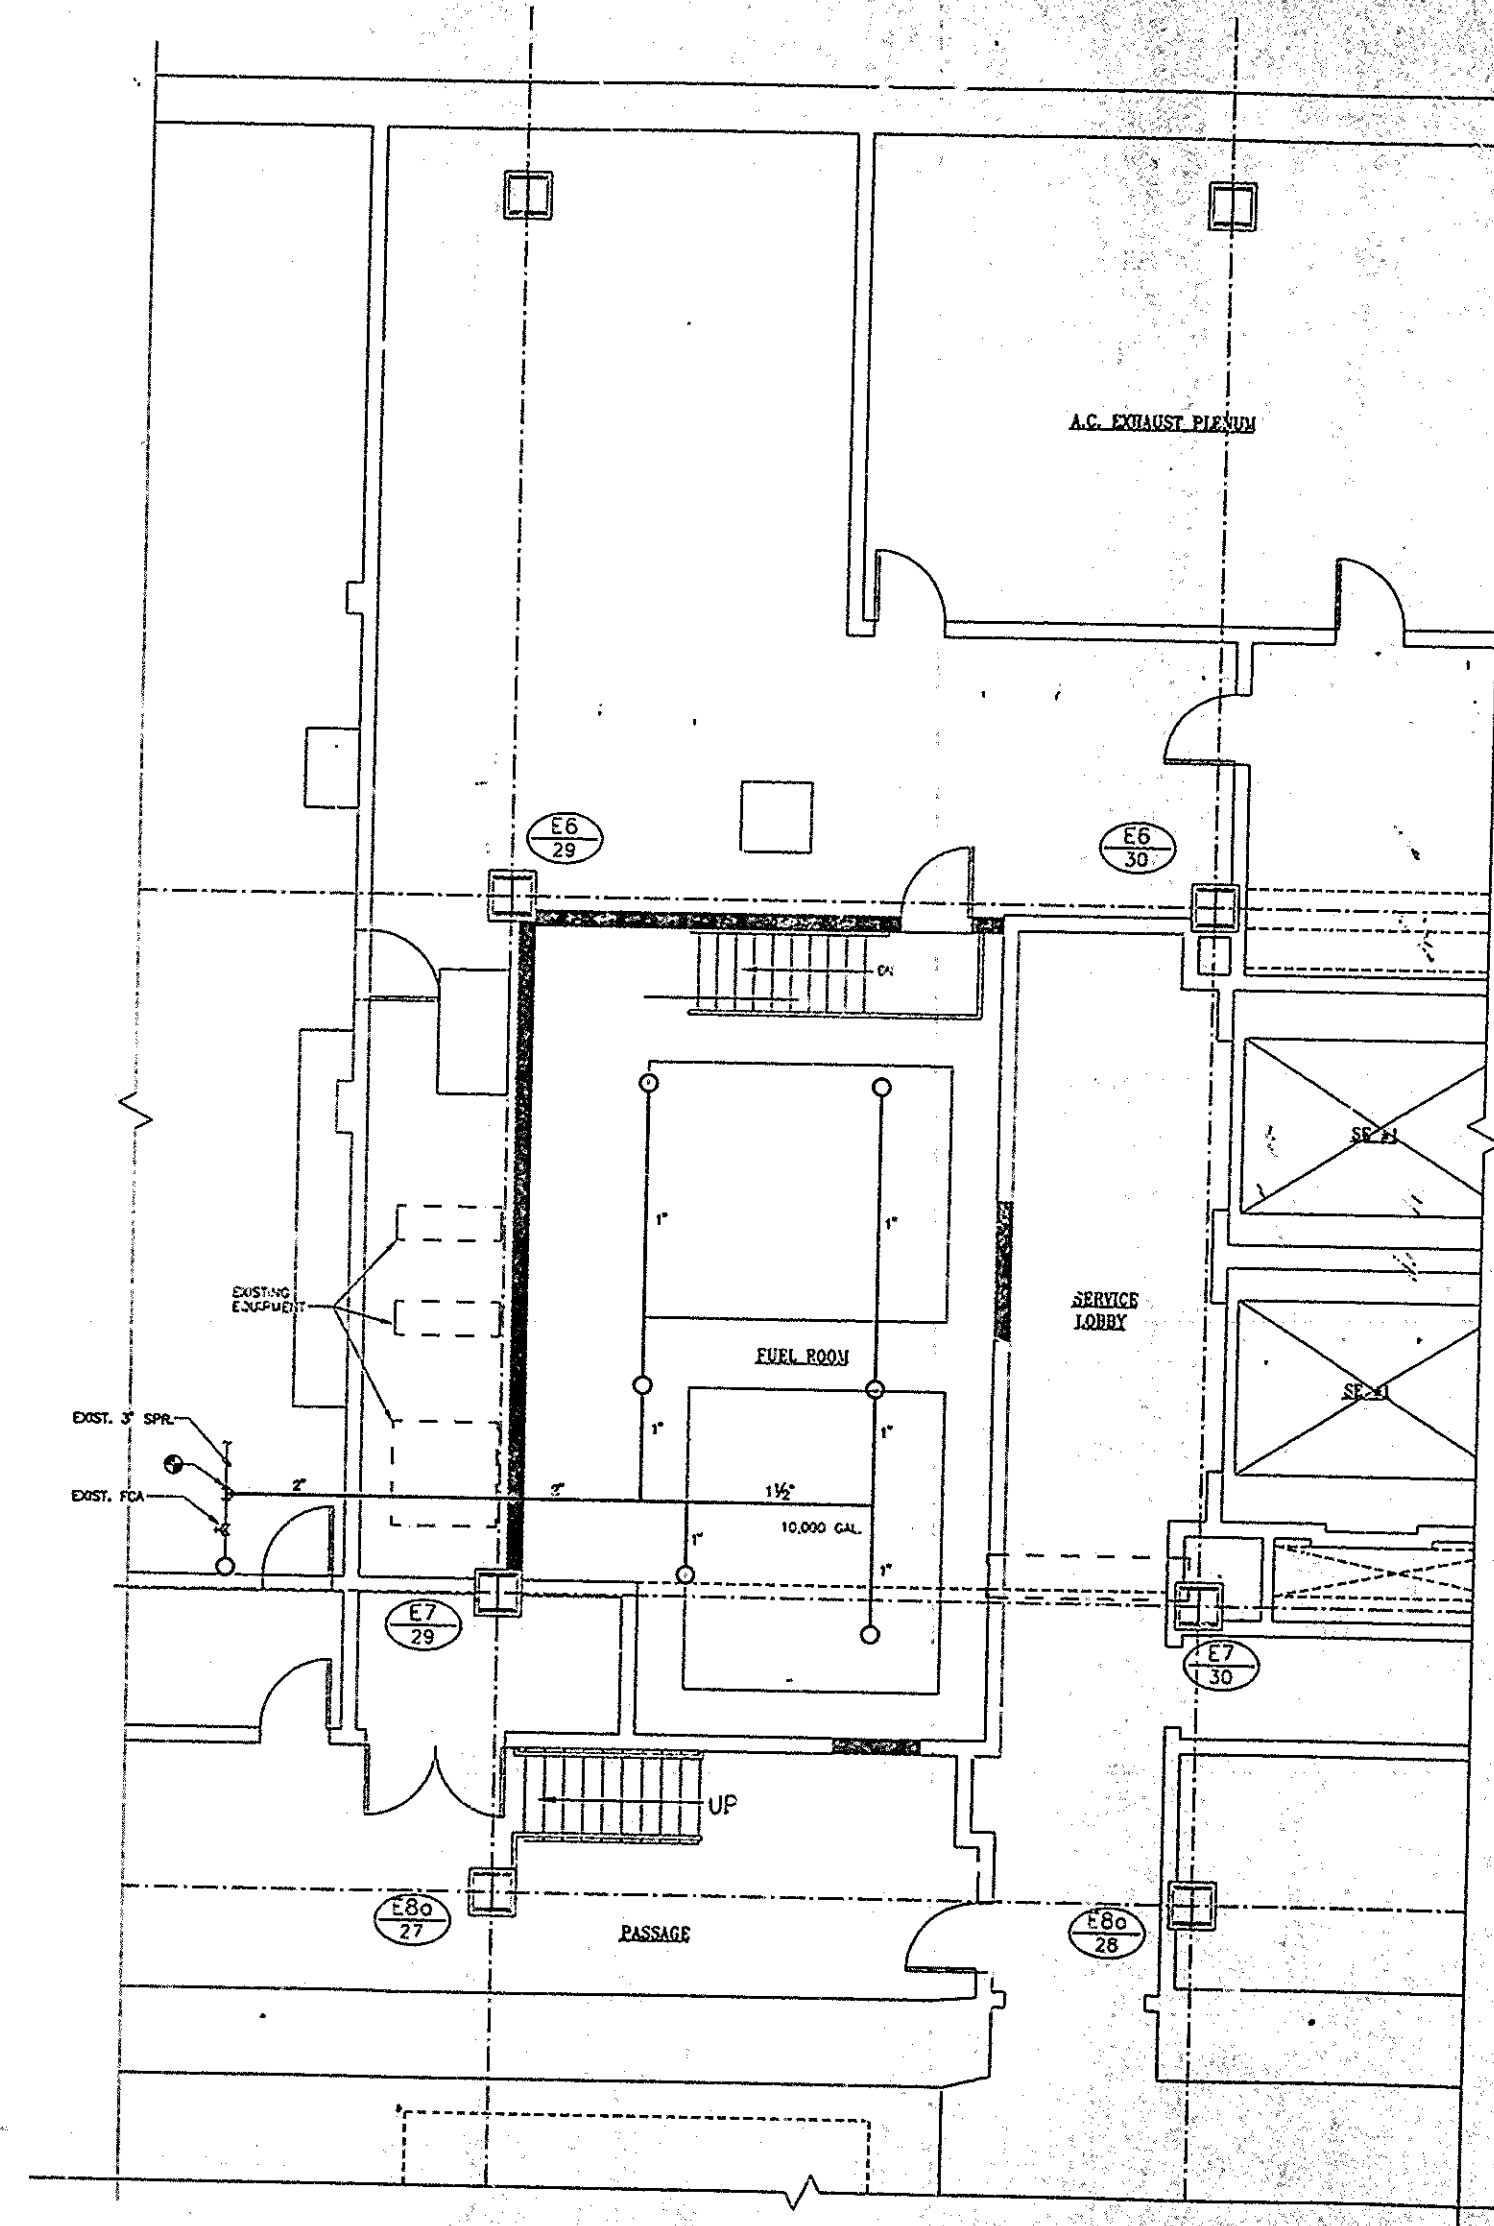

NOTE: LOCATE SPRINKLER DEFLECTORS MIN. OF 1" & MAX. OF 6" BELOW BOTTOM OF 12" STEEL BEAMS

5 WTC PART PLAN B2 LEVEL
FUEL OIL TANK ROOM

